



ECOTEK CANADA PROMOTION TRADE CORPORATION
REGISTERED ADDRESS:
 1188 West Georgia Street, Unit 1660, Vancouver, B.C, Canada, V6E 4A2
 Tel: +1 (778) 928-5580
 Co. Reg. No.: BC0895460
 www.ecotek-canada.vn

ORIGINAL

VALVE REGULATED LEAD ACID BATTERY



Our high quality VRLA batteries are developed with state-of-the-art technology.

- Absorbent Glass Mat (AGM) technology
- Long life
- Small size
- No leakage
- Low self discharge
- No water or electrolyte supplement is required
- Maintenance-free
- They have been widely used in UPS, and other kinds of back-up power.

ECT-UP1220VA3


12V20Ah
MAINTENANCE-FREE

Product



SẢN PHẨM KHÔNG CẦN BẢO DƯỠNG
ĐƯỢC BẢO HIỂM TRÁCH NHIỆM LÊN ĐẾN 2 TRIỆU USD

Dimensions(mm)

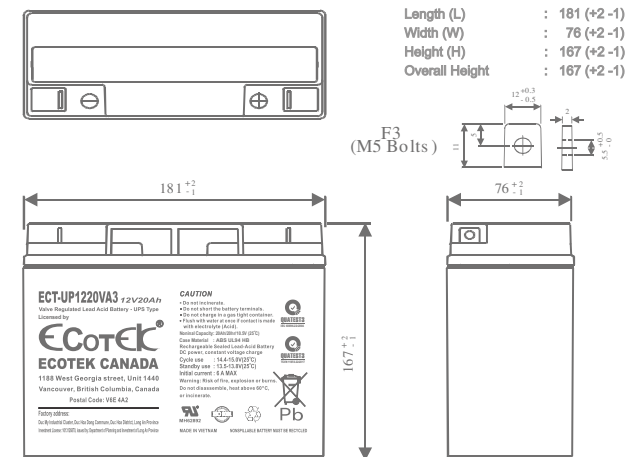

Specifications

Nominal Voltage(V)				12V
Nominal Capacity				
20 hour rate (1A)	to	10.50V)		20Ah
10 hour rate (1.9A)	to	10.50V)		19Ah
5 hour rate (3.4A)	to	10.20V)		17Ah
1 C (20A)	to	9.60V)		12.67Ah
3 C (60A)	to	9.60V)		8Ah
Weight	Approx.			5.95kg
Internal Resistance (at 1KHz)	Approx.			10mΩ
Maximum Discharge Current for				
5 seconds:				300A
Design life				3-5 years
Case Material	ABS - Flame retardant rating of			UL94 HB
	Option:			UL94 V-0
Terminal				F3

Charging Methods at 25°C(77°F)






Cycle use:	
Charging Voltage	14.4 to 15.0V
Coefficient	-5.0mV/°C/cell
Maximum Charging Current	6A
Standby use:	
Float Charging Voltage	13.50 to 13.80V
Coefficient	-3.0mV/°C/cell

Operating Temperature Range

Charge	-15°C(5°F) to 40°C(104°F)
Discharge	-15°C(5°F) to 50°C(122°F)
Storage	-15°C(5°F) to 40°C(104°F)

Charge Retention (shelf life) at 20°C(68°F)

1 month	92%
3 month	90%
6 month	80%

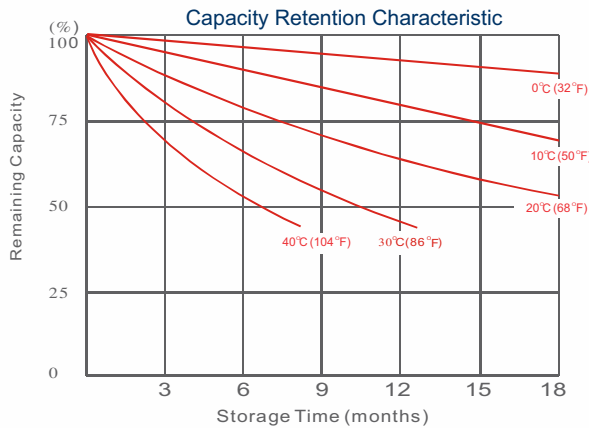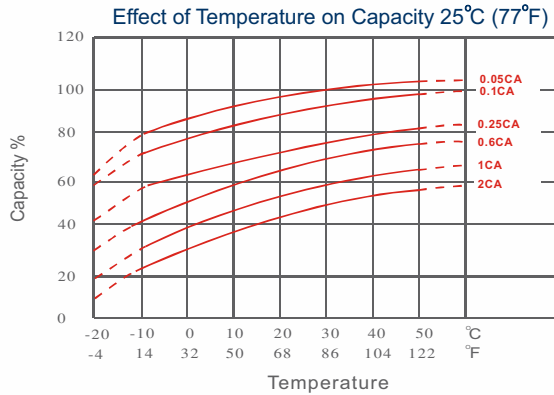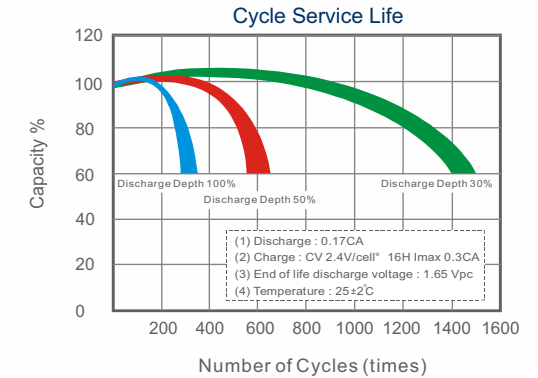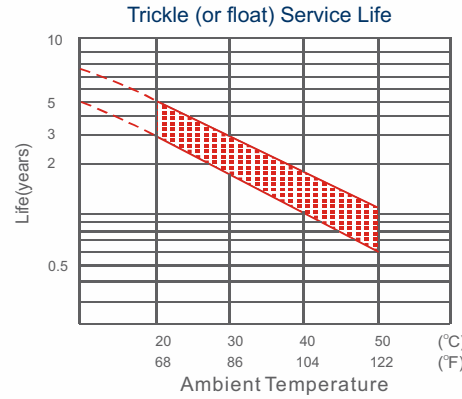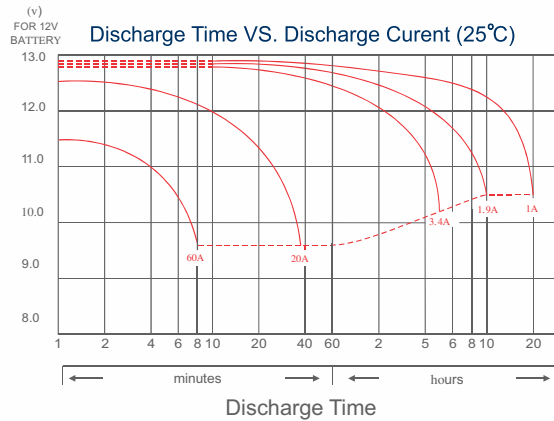

- PERFORMANCE DATA

- Discharge Rates in Watts to Various End Voltages at 25°C (77°F)

Time	End Voltage	1.85V	1.80V	1.75V	1.70V	1.67V	1.65V	1.60V
5	min	108	125	136	143	145	147	149
10	min	77.1	87.0	94.3	98.7	99.8	101	102
15	min	64.5	72.2	78.8	81.8	82.6	83.5	84.4
30	min	34.8	37.2	39.8	41.3	41.8	42.3	42.7
60	min	22.2	23.2	24.0	24.7	24.8	25.2	25.5
120	min	12.2	12.7	13.0	13.5	13.6	13.7	13.8
180	min	9.53	9.88	10.1	10.3	10.4	10.5	10.6
240	min	7.63	7.93	8.12	8.27	8.32	8.38	8.46
300	min	6.65	6.88	7.00	7.10	7.13	7.18	7.24
600	min	3.87	3.98	4.07	4.13	4.15	4.19	4.22
1200	min	2.05	2.12	2.17	2.20	2.22	2.23	2.25

- Discharge Rates in Amperes to Various End Voltages at 25°C (77°F)

Time	End Voltage	1.85V	1.80V	1.75V	1.70V	1.67V	1.65V	1.60V
5	min	68.2	73.9	77.5	80.7	82.0	83.4	85.8
10	min	45.8	48.9	51.4	53.5	54.4	55.4	57.0
15	min	34.7	37.3	39.0	40.5	41.1	41.7	42.6
30	min	18.5	20.0	21.1	22.0	22.2	22.6	23.2
60	min	11.1	11.7	12.2	12.6	12.7	12.9	13.1
120	min	6.25	6.47	6.61	6.73	6.77	6.82	6.89
180	min	4.73	4.90	5.00	5.08	5.11	5.15	5.21
240	min	3.88	3.97	4.04	4.09	4.11	4.14	4.17
300	min	3.41	3.48	3.53	3.57	3.58	3.60	3.62
600	min	1.97	2.00	2.02	2.04	2.05	2.06	2.07
1200	min	1.00	1.03	1.05	1.07	1.08	1.09	1.10

All data on the spec. sheet is an average value:

The tolerance range : $X < 6\text{min}$ (+15%~-15%), $6\text{min} \leq X < 10\text{min}$ (+12%~-12%), $10\text{min} \leq X < 60\text{min}$ (+8%~-8%), $X \geq 60\text{min}$ (+5%~-5%)

Contents in this data sheet are subject to change for improvement without prior notice to users. For clarifications and updated information, please contact us.

CÔNG TY NGUYỄN HÀ
 AUTHORIZED REGIONAL MASTER DISTRIBUTOR IN VIETNAM
 Address : 3/4 Nguyen Van Thu Street, Dakao Ward, District 1, HCM City
 Tell : (028) 39.111.701 - Fax: (028) 39.111.700
 Email : phanphoi@ecotek-canada.vn - dichvu@ecotek-canada.vn
 Website : www.ecotek-canada.vn Call Center: 1800 1558

Factory has been assessed and certified as meeting the requirements of:

- * ISO 14001:2015 Certified by: SGS United Kingdom
- * ISO 45001:2018 Certified by: SGS Taiwan
- * ISO 9001:2015 Certified by: SGS-CSTC Standards Technical Services, China
- * ISO/IEC 17025:2017 Certified by: Ministry Of Science and Technology Of Viet Nam

FACTORY ADDRESS:

Duc My Industrial Cluster, Duc Hoa Dong Commune, Duc Hoa District, Long An Province, Viet Nam

INVESTMENT LICENSE No: 1013126870

ISSUED BY: DEPARTMENT OF PLANNING AND INVESTMENT OF LONG AN PROVINCE